


Legend

Water Mains	Material
Cast Iron	Cast Iron
Concrete Water Line and Coated Steel	Concrete Water Line and Coated Steel
Asbestos Concrete	Asbestos Concrete
Black Iron	Black Iron
Copper	Copper
Concrete Cylinder Pipe	Concrete Cylinder Pipe
Plastic	Plastic

Pipe Material Total 358.3 miles



Percentage Breakdown:

Asbestos Concrete:	0.0011%	Ductile Iron:	61.40%
Black Iron:	0.0041%	Ductile Iron Zinc:	5.94%
Cast Iron:	15.95%	Galv. Steel:	0.35%
Concrete Cylinder:	4.71%	Outside Diameter Steel:	4.40%
CML&C:	4.32%	Plastic:	2.43%
Copper:	0.39%		

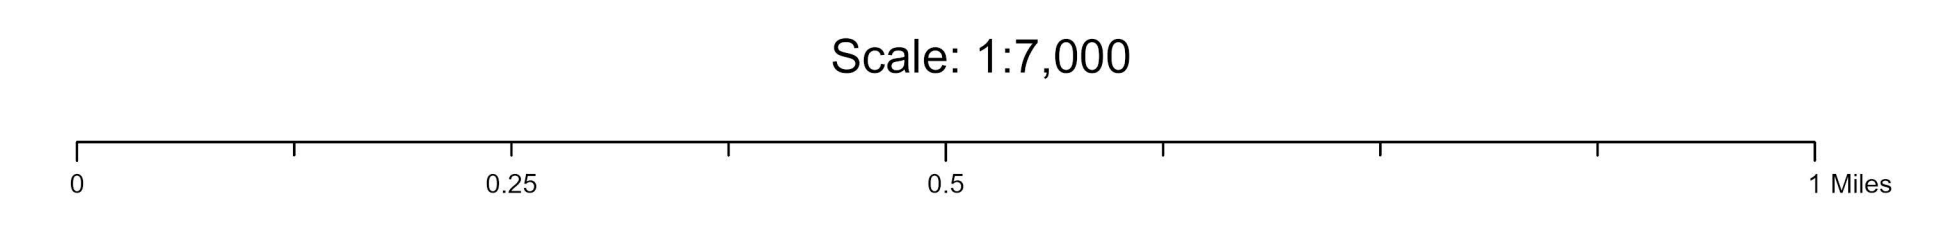

PROJECTION NOTES:
 ELIPSOID: Regional Land Information System (RLIS)
 SPHEROID: MADS 1983 HARN
 DATUM: NORTH AMERICAN 1983 HARN

SOURCE:
 City of Hillsboro GIS - Current as of November 2021
 City of Hillsboro Water Department - Current as of November 2021
 Hillsboro Valley Water District (HVWD) - Current as of November 2021
 Was County - Current as of November 2021

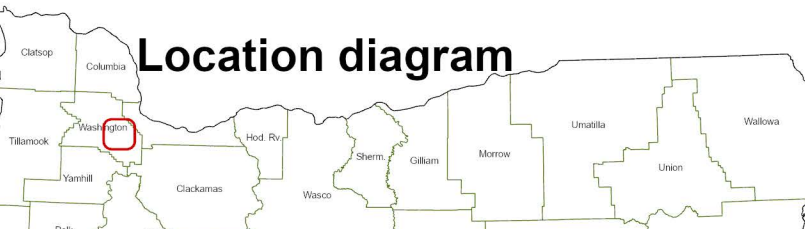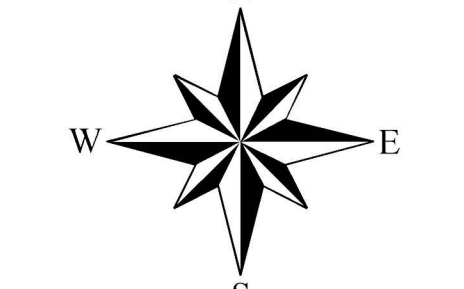

DISCLAIMERS
 This product is for informational purposes and may not have been prepared for, or be suitable for, legal, engineering, or surveying purposes. Users of this information should review or correct the primary data and information sources to address the usability of the information.
 Location of water system facilities does not directly correspond to ownership. Water service boundaries may not correspond to other political boundaries. For additional information contact your local water provider.